

# U P S

DC UPS

240W / 480W

■ USER MANUAL ■

## Table of content

1. IMPORTANT SAFETY INSTRUCTION.....	2
2. Introduction .....	2
3. Installation .....	3
3.1 Rear panel view .....	3
3.2 Connection to Main and Load .....	3
3.3 Wiring Diagram.....	4
4. Operation .....	4
4.1 General Description.....	4
4.2 System Configuration .....	5
4.3 UPS Control .....	5
4.4 UPS Configuration .....	6
5. UPS Monitoring Connection.....	6
5.1 Connect UPS to Computer with RS232 port. ....	6
5.2 UPS RS232 and SNMP PORT.....	6
6. Maintenance .....	6
6.1 Transportation.....	6
6.2 Storage .....	6
6.3 Operation .....	6
6.4 Battery .....	7
<b>6.4.1 Maintenance .....</b>	<b>7</b>
<b>6.4.2 Replacement .....</b>	<b>7</b>
APP-A. Troubleshooting .....	7
APP-B Technical Specifications .....	8

# 1. IMPORTANT SAFETY INSTRUCTION

## WARNING: SAVE THESE INSTRUCTIONS!!

- **WARNING:** Manual contains important instructions of UPS and batteries during installation and maintenance. Follow this instruction at all time
  - **WARNING:** It is recommended to install UPS in an ANSI/NFPA75 room in which temperature and humidity are controlled and free from electrically conductive particles. **DO NOT** expose UPS to direct sunlight or high heat source; **DO NOT** block off ventilation opening around the housing.
  - **CAUTION:** Before conducting maintenance, repair, or shipment, please turn off everything completely and disconnect them.
  - **CAUTION:** The UPS is **NOT** applicable for any inductive loads such as motors or domestic appliances like hairdryers, speakers, and fluorescent lamps.
  - **CAUTION:** All interconnection and power cable should be connected **ONLY AFTER** the UPS shut down and disconnected from main.
  - **CAUTION:** Only use No.26 AWG or larger certified cables to connect UPS and device
  - **CAUTION:** **DO NOT** unplug UPS from main power during operation or protective ground will fail. **DO NOT** disconnect battery under load or shut down may occur.
  - **CAUTION:** Ensure the total leakage current of UPS and the connected equipment under 3.5mA.
  - **CAUTION:** Ensure UPS connects to grounded main power with a fuse or circuit breaker protection.
  - **CAUTION:** Dangerous amount of voltage might still exist even the UPS disconnects from the main power since residual voltage exists due to battery supply.
  - **CAUTION:** Beware of all the details on the cautionary sticker located on UPS.
  - **CAUTION (No user-serviceable parts):** Do not attempt to remove the unit's cover, no user-serviceable parts inside. Please refer all service to qualified service technicians.
  - **CAUTION:** **DO NOT** dispose UPS and its batteries to fire, the battery may explode
  - **CAUTION:** **DO NOT** attempt to open or mutilate the battery.
  - **User's operations:** Users only permits to:
    - Turning the UPS unit on and off.
    - Operating the user interface.
    - Connecting data interface cables.
    - Changing the batteries
  - **CAUTION:** Battery can cause shock and short circuit current. When servicing batteries:
    - A. Remove watches, rings, or other metal objects.
    - B. Use tools with insulated handles.
    - C. Wear rubber gloves and boots.
    - D. Please **DO NOT** place any tools or metal parts on top of batteries.
    - E. Disconnect charging source before connecting/disconnecting battery terminals
    - F. Servicing of batteries should be performed or supervised by personnel with necessary precautions and knowledge. Keep unauthorized personnel away from batteries.
  - **DANGER:** Hazardous electric component inside this unit (example: Heat-sinks) remain energized from the battery supply even when the main power is disconnected.
  - **DANGER:** Battery circuit is not isolated from the AC input. Hazardous voltage may exist at battery terminals and ground—test for safety before any direct contact.
  - **CAUTION:** Remove the battery's pole during service inside the battery cabinet or UPS.
  - **CAUTION:** **ONLY** replace batteries with the same type and quantity
- WARNING (Fuses):** Ensure fuse replacement with the same type and rating **ONLY**.


## 2. Introduction

The information provided in this manual covers 240 / 480W DC uninterruptible power system (UPS). This manual contains basic functions, operating procedures, and emergencies, also including information on how to ship, store, handle, and install the equipment. Only detailed requirements of the UPS units described herein. The installation must carry out according to this manual. The electrical installation must further comply with local legislation and regulations.


### 3. Installation

#### 3.1 Rear panel view

240 / 480W

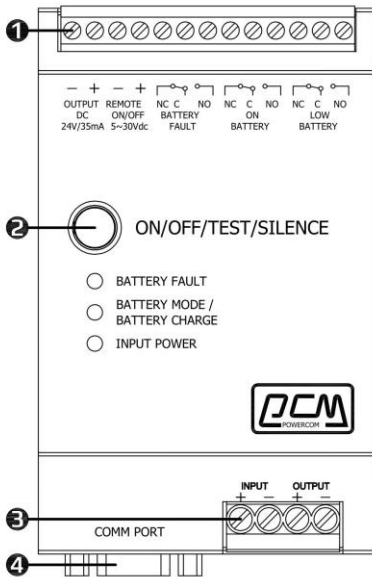

Front View

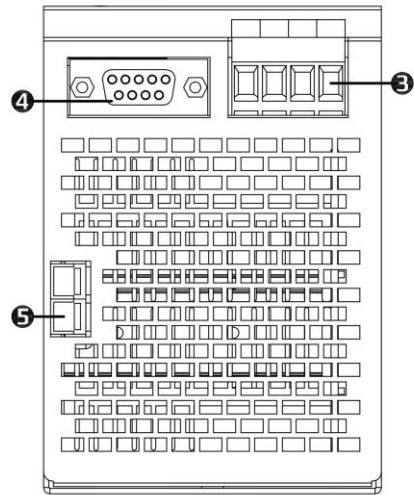

Side View

- ❶ Dry Contact
- ❷ ON / OFF / TEST / BUZZER STOP button
- ❸ DC Input / Output Terminal Block
- ❹ Communication Function
- ❺ Battery Port

**\*Figures only display available function; functions are not on unit if not marked.**

#### 3.2 Connection to Main and Load

- Follow all installation and safety instructions very carefully; failure to do so may cause hazardous situations to personnel and equipment.
- Ensure the main power voltage matches with UPS.
- For electrical installation, closely observe the nominal current rating of the source.
- Check the equipment's power requirement to prevent overloading situations.
- Do not connect devices that draw either massive power shortly or half-wave rectified current - such as hairdryer, vacuum cleaner, laser printer, and plotter.


**Note:** Although you may use the UPS immediately, maximum back up time will not be available yet. It is recommended to charge the batteries for a minimum of 8 hours before use

- Connect the loads to the output wire connector.

Screw	M3.0 ; Current rating = 30A , AC 300V
Insulation Withstands Volts	AC 2000V/min.
PCB Hole Diameter	1.8mm , wire strip length = 8mm
Screw Torque	9 lb.-in
DC Input / Output Terminal Block	12-16 AWG
Dry Contact Relay Terminals	16-22 AWG

3.3 Wiring Diagram

UP to 4 DBC-24V modules can be connected in parallel with the power modules DRD-240 or DRD-480.

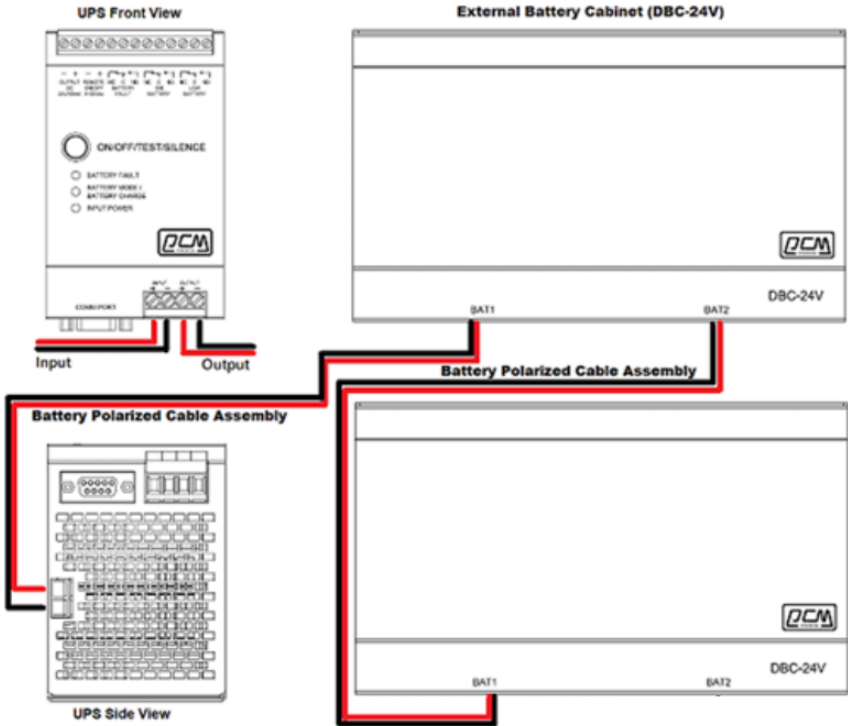

Power Module: DRD-240 or DRD-480

Battery Module: DBC-24V

4. Operation

Necessary information for the operation of the unit is covered in this chapter. Normally UPS runs automatically, but on a few occasions such as just after installation, all procedures are described herein.

4.1 General Description

As a DC UPS, it provides reliable protection to your daily equipment while automatically charges the battery.

- Main power transfers to your equipment with surge protection
- During a power failure, the UPS immediately provides backup power from the battery.

### Line-Mode/Battery-Mode

UPS will operate in Line-Mode that supports power and charge battery while connected to power. During a power failure, the UPS will switch to Battery-Mode, in which power is maintained from the battery. In case of failure time exceed Battery-Mode duration, UPS will shut down until voltage return to prevent battery discharge.

### Diagnostic Test

While the advanced battery management system monitors the conditions of the batteries, it sends early warnings if a battery replacement is needed. Diagnostic tests can be performed from the control panel.

### 4.2 System Configuration

The UPS device and battery make up the system. Depending on site and load requirements, certain additional options are available as tailored solutions. Please consider the following when planning your UPS system:

- The total demand for the protected system shall dictate the output power watts (W). When measuring demand, please allow a margin for future expansion and calculation error.
- Battery-mode duration needs dictate the battery size. If the load is less than the UPS nominal power rating, then the actual backup time is longer.

### 4.3 UPS Control

#### Control panel functions

Status	LED (GREEN)	LED (YELLOW)	LED (RED)	Buzzer
Normal Mode	ON	OFF	OFF	OFF
Backup Mode	OFF	ON	OFF	ON : 1'S OFF : 4'S
Battery Fault (Normal Mode)	ON	OFF	ON : 1S OFF : 2S	OFF
Battery Charging (Normal Mode)	ON	ON : 1S OFF : 2S	OFF	OFF
Battery Charging (Power Off)	OFF	ON : 1S OFF : 2S	OFF	OFF
Battery Low (Backup Mode)	OFF	ON	OFF	ON : 1S OFF : 1S
Overload	ON(Normal Mode)	ON(Backup Mode)	ON	ON
Remote shutdown	ON(Normal Mode)	ON(Backup Mode)	OFF	Bi-bip
Button Display				
On/Off/Test /silence	ON/OFF/TEST/Silence Button The master button for UPS control, refer to Button Operation			

#### Button operation

##### Cold Start function

When the main power is disconnected from UPS, it is capable of starting with battery power for users' needs. Simply start the UPS as the instruction below.

##### "On/Off/Test/Silence" button

##### Turn on the UPS

Press the "ON" button until a single "beep" alarm disappeared or the LED display turns on.

##### Shut Down the UPS

- Press the "OFF" button for 3 seconds during Line/Battery-mode.
- (If applicable) To avoid electrical hazards, please turn off the internal/external input breaker. Then, turn off any external battery breaker and wait till all fans completely shut down.

##### Test

Press once to start self-test function during Line-Mode

##### Silence

Press once to enable/disable alarm buzzer during Battery-Mode

**Note:** Remote ON/OFF: You can connect external control, which will function the same as the "On/off/Test/Silence" button.

##### Green mode

The Green mode feature will enable UPS no-load or light-load shutdown to maintain power consumption and battery life. During battery mode, the UPS will shut down approximately 3 min with no load/light load operating.

Green mode can also be enabled or disabled via monitoring software.

The UPS will indicate Green mode with follow up alarm after UPS start-up alarm.

Green Mode enable: Triple Beep

Green Mode disable: Double Beep

Green Mode enable: When turning on UPS, please keep holding the “ON” button until a triple “beep” occurred.

Green Mode Disable: Turn on UPS normally. Green mode disables in default.

#### 4.4 UPS Configuration

##### UPS Manual test

Manual tests for UPS or battery can be conducted from the UPS configuration as well and are functional even when the UPS is not charging the battery.

**Simple test:** It's recommended to conduct a simple simulation test when

1. The first use of UPS.
2. Adding new loads.
3. 6 months' regular check-up

Switch on the UPS and wait for the power indicator to light up, then unplug UPS to simulate the main power failure. Manual Battery Test: Press the “test” button once. UPS will automatically conduct a self-test. Please note that the UPS will briefly switch to battery mode.

## 5. UPS Monitoring Connection

UPSMON Pro software (Or other power monitoring software) can further utilize the UPS with warning reminders, monitoring, control shut down, and setting adjustments.

Using monitoring features requires connecting the UPS to a computer or the internet

##### 5.1 Connect UPS to Computer with RS232 port.

- Locate the RS232 port on UPS.
- Connect with factory-provided/approved communication cable.
- Ensure your computer can install and support power management software.

##### 5.2 UPS RS232 and SNMP PORT

- The RS-232 interface uses a 9-pin female D-sub connector.
- The RS-232 port carries the data about utility, load, and UPS.
- Through SNMP adapter, your UPS becomes SNMP manageable.  
Detail information about interface ports pins and their functions are available upon request. Please contact for technical assistance.

## 6. Maintenance

Please read the following instruction to ensure your safety and maintain a longer product lifetime.

This section contains detailed information about moving, maintaining, and placing the UPS. With a minimal amount of maintenance, you can expect the UPS to function smoothly.

##### 6.1 Transportation

Please handle UPS with extreme caution since a high amount of energy is within the batteries. Keep the unit in position as marked on the packaging and never drop the unit.

##### 6.2 Storage

Please read the following instructions if the UPS is not installed immediately:

- Store the equipment as is in its original packing and shipping carton.
- Do not store in temperatures outside the range of +15°C to +25°C.
- Protect the equipment from wet or damp areas and moist air.
- To maintain the vitality of the batteries, please recharge the UPS at least 8 hours every six months.

##### 6.3 Operation

**CAUTION:** Ensure that all environmental concerns and requirements are met according to safety instruction; otherwise, the safety of installation personnel cannot be guaranteed since the unit may malfunction.

- Please ensure no flammable substances such as gases or fumes.
- Avoid extreme temperature and humidity. Protect the equipment from moisture.
- Ensure there is enough space (300mm or above recommended) at the rear and side of UPS for proper ventilation.
- Ensure that the front of the UPS remains clear for user operation.
- **Only** authorized agents or technicians may service the unit.
- **Do not** open the UPS cabinet. Components may contain hazardous or fatal voltage.
- Output receptacles may carry live voltage without connecting to the main power.
- Pay special attention to UPS air inlet; **do not** let it coved by dust.

## 6.4 Battery

### 6.4.1 Maintenance

The reliability of the battery is heavily related to the environmental issue.

At the temperature of 25 degrees Celsius, A regular 6-12 months' checkup is advised.

### 6.4.2 Replacement

Please contact for technical assistance.

1. Ensure UPS is turned off and disconnected from the main power.
2. Remove the battery cover from the bottom of UPS.
3. Disconnect battery wire and remove the battery pack
4. Replace with the same type and number of battery
5. Reconnect the battery and reinstall the cover.

## APP-A. Troubleshooting

Troubleshooting procedures give simple instructions in determining UPS malfunctions. Start the troubleshooting procedure if you witness any alarm indication.

### Alarm

The UPS has an audible alarm. When different situations occurred, UPS will alert users with display and buzzer.

#### Battery-mode (Slow alarm)

During battery mode, the alarm will beep every 4 seconds. The alarm will stop when UPS return to Line-mode.

#### Battery-Low (Rapid alarm)

During Battery-low (less than 30%), the UPS will beep every 0.5 seconds. The alarm will stop when UPS shutdown or returns to Line-mode.

#### Overload/Fault (Constant alarm)

When UPS operating with load exceeded its maximum capacity, UPS will emit a continuous alarm to warn an overload condition. UPS will automatically turn off to protect your essential load. Please consider remove or shutdown less-essential loads.

Also, when the unit encounters other problems (battery failure, charger failure), the unit emits the alarm. Please refer to the function description and troubleshooting chart to identify the precise cause.

**Silencing Alarm** Here is the instruction to mute the active alarm or future alarm notification:

**Note:** During battery-mode, if the battery is low on power, the alarm will sound regardless of silent-mode enable/disable.

Silent alarm Enable/Disable: Press the "on" button during the Battery-Mode alarm.

If troubleshooting does not include or resolve your situation, feel free to contact for technical assistance.

PROBLEM	POSSIBLE CAUSE	Solutions
UPS can't operate switching on. No lights on, no warning sounds appear	Power source mistake or low battery power	Check out the main power source connection If operating with battery power, ensure enough charging time for UPS
	Time of pressing the button is too short	Press and hold the "ON" button for a longer duration
	Output short circuit or overload on UPS	Turn off UPS and take off all load. Check for any potential internal short circuit Then attempt to turn on UPS again
	Hardware failure	Contact for technical assistance
	Battery out of order	Replace battery
UPS always remain on battery-mode regardless of main power connection	No power source input	Check the main power source and cable
	Fuse melted or Circuit breaker tripped	Reset the breaker or replace the fuse (spare fuse is in UPS inlet). then restart the UPS
	The main voltage is out of the UPS input range	UPS function normally Check your main power voltage
Overload/Battery Fault indicator lit or constant buzzer beeping	UPS load exceed capacity; UPS overloading	Remove or shut down the less essential load
	Battery not connected or low on power	Check the UPS batteries; make sure they are well connected. If there is any damage on battery packs, replace them ASAP
	Battery out of order	Replace battery



Battery mode duration below expectation	Batteries aren't fully charged Batteries are worn out or faulted	Ensure enough recharge time for UPS Run a self-test to check battery status Replace UPS battery if the problem remains
	The charger is out of order	Contact for technical assistance
	Green mode enabled No-load or light load shutdown engaged	Operation normal. Turn off green mode to disable such function

## APP-B Technical Specifications

Model	DRD-240	DRD-480
Configuration		
Capacity (VA/ Watts)	240 W	480 W
Form	Din Rail Mounting Type	
Input		
Voltage	24VDC	
Input Voltage Range	22.5 - 30VDC	
Output		
Voltage	21 - 30VDC	
Transfer Time	0 ms	
Protection		
Full Protection	Overload, Surge, Short Circuit	
Charging		
Charger Voltage	27.6 V max.	
Charger Current	0.5A max.	
Time to Fully Charge	8 hours to 90% capacity after fully discharge	
Charge Rate	0.1C	
Management & Communication		
Indicator	LED Panel	
Communication Port	RS232, Dry Contact	
Physical		
Dimensions (WxDxH) (mm)	122.5 x 75.9 x 109.4	
Weight (kgs)	0.97	
Shipping Dimensions (mm)	171 x 125 x 162	
Shipping Weight (kgs)	1.28	
Alarm		
Overload / Fault	Continuous Beeping	
Battery Mode	Beep every 4 seconds	
Low Battery	Beep every 0.5 second	
Environment		
Operating Humidity	0-90 % RH at 0-50°C (Non-condensing)	
Audible Noise	Less than 40 dB	

<b>External Battery Cabinet (DBC-24V)</b>	
Nominal Voltage	24 VDC
Type & Quantity	12V 5Ah x 2
Sealed, Maintenance Free	Yes
Protection	Fuse: 30A
Terminal Connector Type	Polarized Powerpole Connectors
External Battery Cabinets Quantity (Max.)	4 sets
Dimensions (WxDxH) (mm)	210 x 123.9 x 110
Weight (kgs)	5.75
Shipping Dimensions (mm)	298 x 203 x 197
Shipping Weight (kgs)	6

\* Specifications are subject to change without further notice.

\* Specifications are for reference; actual information should be based on real product.

20250416  
661-DRU0-001-00R